

Maxi Coil - MC

600-1000 l.

NO-EN



SIKKERHETSINFORMASJON
FDV INFORMASJON
MONTASJEANVISNING

Manufactured by OSO Hotwater AS
Industriveien 1 - 3300 Hokksund - Norway
Tel: +47 32 25 00 00 / E-mail: oso@oso.no
www.osohotwater.com

11002346-146194-03B - 03-2023

OSO
HOT WATER


INNHOLDSFORTEGNELSE

| | |
|---|----|
| 1. Sikkerhetsinstruks | 3 |
| 1.1 Generell informasjon | 3 |
| 1.2 Sikkerhetsinstruks for brukeren | 4 |
| 1.3 Sikkerhetsinstruks for installatøren..... | 4 |
| 2. Produktbeskrivelse | 5 |
| 2.1. Produktidentifikasjon..... | 5 |
| 2.2. Bruksområde..... | 5 |
| 2.3 CE merking..... | 5 |
| 2.4 Tekniske data | 5 |
| 2.5. Reservedeler | 5 |
| 3. Installasjonsinstruks | 6 |
| 3.1. Produkter omfattet av instruksen | 6 |
| 3.2. Medfølgende i leveransen..... | 6 |
| 3.3. Produktdimensjoner | 6 |
| 3.4. Krav til installasjonssted | 7 |
| 3.5. Rør-installasjon | 8 |
| 3.6. El-installasjon | 10 |
| 4. Igangsettelse første gang | 12 |
| 4.1. Fylling av vann..... | 12 |
| 4.2. Påsettelse av strøm..... | 12 |
| 4.3. Kontrollpunkter..... | 12 |
| 4.4. Tømming av vann..... | 12 |
| 4.5. Overlevering til sluttbruker..... | 12 |
| 5. Brukerveiledning | 13 |
| 5.1. Innstillinger..... | 13 |
| 5.2. Årlig kontroll..... | 13 |
| 5.3 Vedlikehold..... | 13 |
| 6. Feilsøking | 14 |
| 6.1. Feil og løsninger..... | 14 |
| 7. Garantibetingelser | 15 |
| 7.1. Garanti og garantiregistrering | 15 |
| 7.2. Kundeservice..... | 15 |
| 8. Demontering av produktet | 15 |
| 8.1. Demontering..... | 15 |
| 8.2. Returordning..... | 15 |

1. SIKKERHETSINSTRUKS

1.1 Generell informasjon



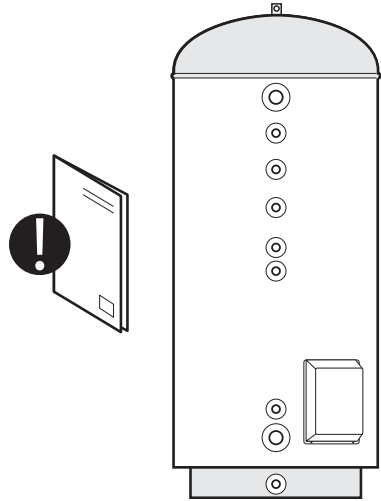


- Les følgende sikkerhetsinstruks grundig før installering, vedlikehold eller justering av akkumulatortanken
- Personskade eller materiell skade kan oppstå hvis produktet ikke monteres eller brukes på tiltenkt måte.
- Oppbevar denne manualen og andre relevante dokumenter slik at de er tilgjengelige for fremtidig referanse.
- Produsenten forutsetter overholdelse av sikkerhets-, drifts- og vedlikeholdsinstrukser som medfølger (sluttbruker), samt samsvar med montasjeanvisning, gjeldende standarder og forskrifter på installasjonstidspunkt (installatør).






Symboler benyttet i denne anvisningen:





| | | |
|--|-----------|---|
| | ADVARSEL | Mulighet for alvorlig personskade eller død |
| | FORSIKTIG | Mulighet for mindre eller moderat skade på person eller eiendom |
| | | FORBUDT å utføre |
| | | SKAL utføres |





1.2 Sikkerhetsinstruks for brukeren

|  ADVARSEL | |
|--|---|
|  | Sikkerhetsventilens overløp skal IKKE tettes eller plugges. |
|  | Produktet skal IKKE modifiseres eller endres fra sin originale tilstand. |
|  | Barn skal IKKE leke med produktet, og ikke oppholde seg ved produktet uten tilsyn. |
|  | Vedlikehold / innstillinger skal kun utføres av personer over 18 år, med tilstrekkelig kompetanse |

|  FORSIKTIG | |
|---|---|
|  | Produktet skal ikke utsettes for frost, overtrykk, overspenning eller klorbehandling. Se garanti-bestemmelser. |
|  | Vedlikehold / innstillinger skal ikke utføres av personer med nedsatte fysiske eller mentale evner, med mindre de har fått instruksjoner om bruk av noen ansvarlig for deres sikkerhet. |

1.3 Sikkerhetsinstruks for installatøren

|  ADVARSEL | |
|--|---|
|  | Sikkerhetsventilens overløp skal IKKE tettes eller plugges. Sikkerhetsventil medfølger produktet. |
|  | Evt. overløpsrør fra sikkerhetsventil SKAL være ≥ 18 mm. innvendig, uavstengbart, brutt og frostfritt m/fall til sluk. |
|  | Gjeldende forskrifter, standarder og denne montasjeanvisning skal følges. |

|  FORSIKTIG | |
|---|--|
|  | Produktet skal plasseres i rom med sluk, utført iht. våtromsnormen / siste TEK. Alternativt skal aut. vannstoppventil med sensor og overløp fra sikkerhetsventil til sluk monteres. Produktansvar gjelder kun hvis dette blir fulgt. |
|  | Produktet skal monteres loddrett og i vater, på gulv eller vegg egnet for totalvekt av produktet i drift. Se merkeplate. |
|  | Produktet skal ha fri serviceavstand på 40 cm foran el-sentral. |

2. PRODUKTBEKRIVELSE

2.1 Produktidentifikasjon

Identifikasjon for ditt produkt finnes på merkeplaten festet til produktet. Merkeplaten inneholder informasjon om produktet iht. EN 12897:2016 og EN 60335-2-21, i tillegg til andre nyttige data. Se samsvarserklæring på www.osohotwater.com for mer informasjon.

OSO produkter er designet og produsert iht.:

- Trykkstandard PED 2014/68/EU
- Sikkerhetsstandard EN 60335-2-21
- Sveisestandard EN ISO 3834-2

OSO Hotwater AS er sertifisert iht.

- Kvalitet ISO 9001
- Miljø ISO 14001
- Arbeidsmiljø ISO 45001

2.4 Tekniske data

| NRF nr. | Produktkode: | Kapasitet personer | Vekt kg. | Dia x høyde mm | Frakt vol. m ³ | Oppv. tid timer Δt 65°C | Faktisk vol. l. |
|---|--|-----------------------|----------|------------------------|---------------------------|---------------------------------|-----------------|
| 800 1773 | MC 600 - 15 kW / 3x230V + HX 1,0 m ² | - | 143 | ø780x2030 | 1,28 | - | 567 |
| 800 1754 | MC 1000 - 15 kW / 3x230V + HX 1,0 m ² | - | 244 | ø1000x2100 | 2,29 | - | 877 |
| Direktiv: 2010/30/EU Regulativ: EU 812/2013 | | Direktiv: 2009/125/EC | | Regulativ: EU 814/2013 | | | |
| Varmetapstestet iht. standard: EN12897 : 2015 | | | | | | | |

Produktene er kategorisert som IP21.

2.5 Reservedeler

| NRF nr. | Betegnelse | Produktbeskrivelse: | Dimensjon |
|----------|-----------------|---|----------------|
| 71278 | RG 5/4" | Element - 5 kW/1x230V - 2-rørs - Incoloy 825 | Lengde 450 mm. |
| 801 5823 | TS2 | Termostat - 59T/66T 60-90°C 1fas | 2-polig |
| 56031 | AN | Anode - 3/4" | Lengde 800 mm |
| 81800 | Koblingsledning | Internledning - 4#, lilla | På rull |
| 81835 | Koblingsledning | Internledning - 4#, sort, gaffel+øye | Lengde 280 mm |
| 81840 | Koblingsledning | Internledning - 4#, sort, gaffel/knekt+øye | Lengde 280 mm |
| 81902 | Koblingsstykke | Ouneva - VC05-0012 5x1x2,5-35mm ² | |
| 92027 | PT 3/4" | Sikkerhetsventil - trykk&temp. 10 bar / 90-95°C - Caleffi | G3/4"M |

2.2 Bruksområde

Maxi Coil er beregnet brukt som akkumulator for tappevann med el spisslast. MC er forberedt for ekstern energikilde.

2.3 CE merking



CE merket viser at produktet er i samsvar med de aktuelle direktivene. Se samsvarserklæring på www.osohotwater.com for mer informasjon.

Produktet er i samsvar med direktiver for:

- Lavspenning LVD 2014/35/EU
- Elektromagnetisk kompatibilitet EMC 2014/30/EU
- Trykkutstyr PED 2014/68/EU

Sikkerhetsventil(er) benyttet skal være CE merket og samsvare med PED 2014/68/EU.

3. INSTALLASJONSINSTRUKS

3.1 Produkter omfattet av denne instruksen

800 1773 Maxi Coil - MC 600 - 3x230V

800 1754 Maxi Coil - MC 1000 - 3x230V

3.2 Medfølgende i leveransen

| Ref no. | Antall | Beskrivelse |
|---------|--------|--|
| 1 | 1 | Akkumulatortank med el. spisslast + coil |
| 2 | 1 | Montasjeanvisning (dette dokument) |
| 3 | 1 | Anode (fabrikkmontert) |
| 4 | 2 | PT sikkerhetsventil (medfølger) |
| 5 | 1 | El-sentral med 3 elementer/termostater |




Produktet leveres med 2 stk. PT sikkerhetsventiler.

3.3 Produktdimensjoner

Alle mål i mm.


| Produkt | A | B | C | D | E | Ø |
|---------|------|------|-----|-----|-----|------|
| MC 600 | 2030 | 1530 | 830 | 380 | 260 | 780 |
| MC 1000 | 2100 | 1680 | 990 | 430 | 310 | 1000 |

Toleranse +/- 5 mm.

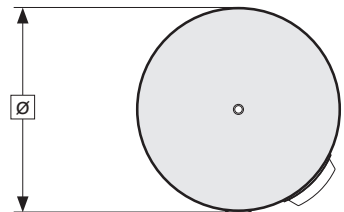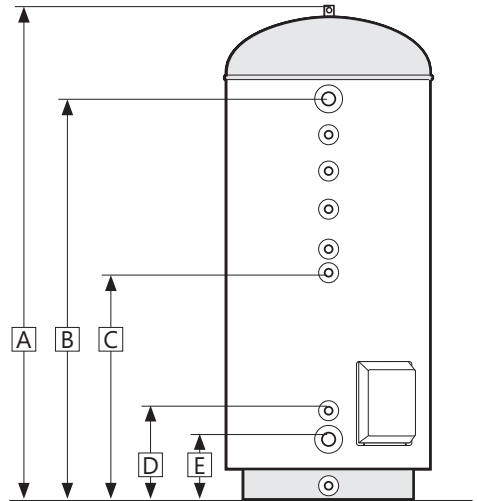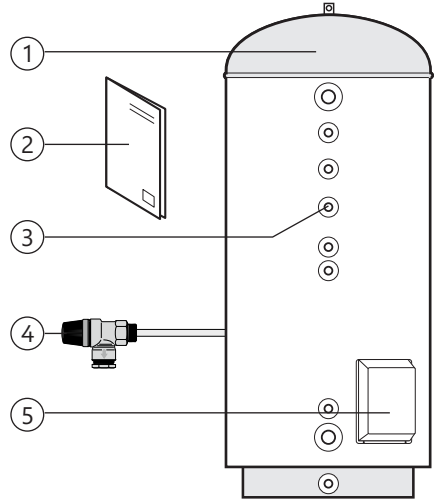

3.3.1 Inntransport

Produktet skal transporteres varsomt som illustrert, med emballasje.

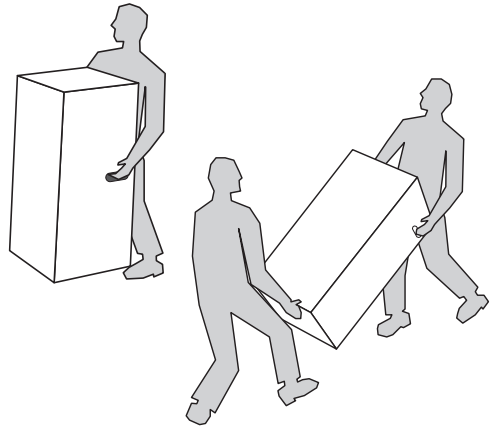



⚠ FORSIKTIG

Stusser, ventiler og lignende skal ikke benyttes til å løfte produktet da dette kan forårsake funksjonsfeil.

3.4 Krav til installasjonssted og plassering

⚠ FORSIKTIG

| | |
|----------|--|
| ! | Produktet skal plasseres i rom med sluk, utført iht. våtromsnormen / siste TEK. Alternativt skal aut. vannstoppventil med sensor og overløp fra sikkerhetsventil til sluk monteres. Produktansvar gjelder kun hvis dette blir fulgt. |
| ! | Produktet skal plasseres i et tørt og permanent frostfritt miljø. |
| ! | Produktet skal plasseres på gulv eller vegg egnet for totalvekt av produktet i drift. Se merkeplate. |
| ! | Produktet skal ha fri serviceavstand på 40 cm foran el-sentral. |
| ! | Produktet skal være enkelt tilgjengelig for service og vedlikehold. |

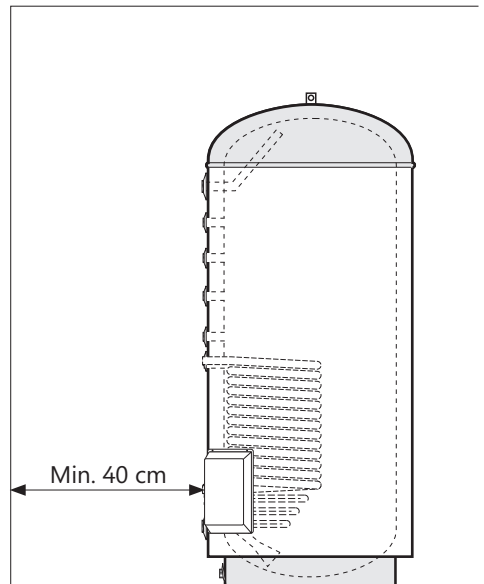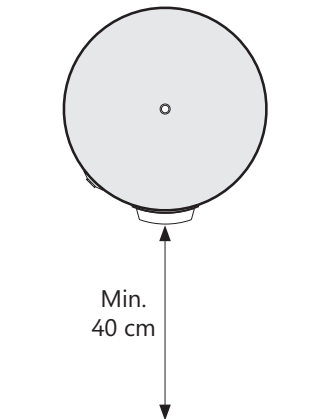

3.5 Rør-installasjon

Produktet er beregnet å være permanent tilkoblet hovedvanntilførsel. Ved installasjon skal godkjente rør av korrekt dimensjon benyttes. Gjeldende standarder og forskrifter skal følges.

| Nr | Dimensjon | Anslutning beskrivelse |
|----|------------------|---------------------------------|
| 1 | G1 1/2" internal | Varmtvann ut |
| 2 | G3/4" internal | PT sikkerhetsventil 1 |
| 3 | G3/4" internal | Varmtvann sirkulasjon / Termom. |
| 4 | G3/4" internal | Anode (fabrikkmontert) |
| 5 | G3/4" internal | PT sikkerhetsventil 2 |
| 6 | G1" internal | Coilanslutning øvre |
| 7 | G1" internal | Coilanslutning nedre |
| 8 | G1 1/2" internal | Kaldtvann inn |
| 9 | G1" internal | Avtapning |

3.5.1 Inngående vanntrykk

Produktets effektivitet avhenger av inngående kaldtvannstrykk. Vanntrykket bør være minimum 2 bar og maksimum 6 bar over hele døgnet. For høyt vanntrykk kan justeres ved å installere en trykkreduksjonsventil.




3.5.2 Montering av rør

- Rør i egnet dimensjon legges frem til viste anslutninger og tilkobles med egnet tetningsmiddel. Anslutninger som ikke benyttes må plugges forsvarlig.
- Produktet kan seriekobles for økt kapasitet i anlegget. Benytt OSO prefabrikerte SRS samle rør. Se illustrasjon.

3.5.3 Montering av overløpsrør

Evt. overløpsrør (11) ≥ 18 mm. innvendig føres til PT sikkerhetsventil;

- Kobles til overløp (10) på PT sikkerhetsventil (3/4" innvendig gjenge).
- Føres uavstengbart, brutt og frostfritt med fall til sluk.

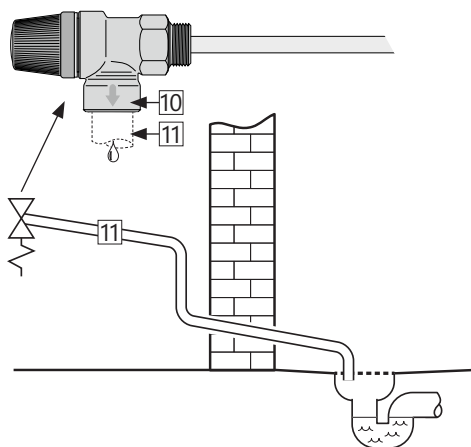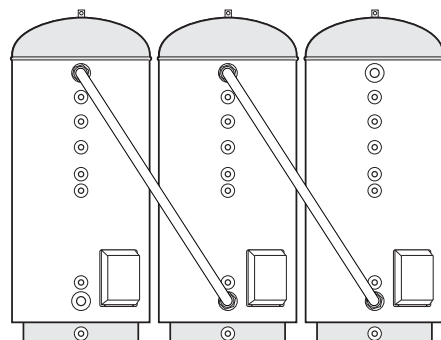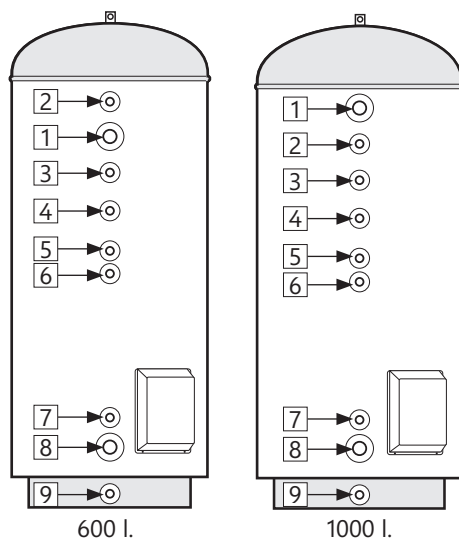

3.5.4 Montasjeinstruks

| ⚠ FORSIKTIG | |
|-------------|--|
| ❗ | Produktet skal plasseres i rom med sluk, utført iht. våtromsnormen / siste TEK. Alternativt skal aut. vannstoppventil med sensor og overløp fra sikkerhetsventil til sluk monteres. Produktansvar gjelder kun hvis dette blir fulgt. |
| ❗ | Produktet skal monteres loddrett og i vater, på gulv egnet for totalvekt av produktet i drift. Se merkeplate. |
| ❗ | Produktet skal ha fri serviceavstand på 40 cm foran el-sentral. |

3.5.5 Montasjeanbefaling

| ANBEFALING | |
|------------|---|
| - | Dersom maksimalt vanntrykk overstiger 6 bar over døgnet, bør reduksjonsventil og ekspansjonskar monteres. |
| - | Ved installasjon i rom som ikke er utført iht. våtromsnormen, bør vanntett spillbakke med overløpsrør ≥ 18 mm. innv. til sluk monteres under produktet, i tillegg til aut. vannstoppventil med sensor. Dette vil forebygge mot evt. materielle skader. |

3.6 El-installasjon

Fast el. montasje skal benyttes ved installasjon. El-montasje skal utføres av aut. elektriker. Gjeldende standarder og forskrifter skal følges.

3.6.1 Elektriske komponenter

| Komponent | Merknad |
|---------------------|------------------|
| Sikkerhetstermostat | 95°C termouløser |
| Arbeidstermostat | 50-75°C stillbar |
| Varmeelement | 3fas 230V |
| Internledninger | Varmebestandig |

3.6.2 Elektriske tilkoblinger i el-boks



Kontinuerlig spenning er tilstede på tilkoblingspunktene. Før elektrisk arbeid utføres skal strømtilførsel brytes og sikres mot påsetting mens arbeid pågår.

A) Tilførselsledning kobles på koblingsstykke (1) som vist. Tilførselsledninger skal sikres med

egnet strekkavlaster.


- B) Internledninger fra koblingsstykke (1) til termostater samt ledninger fra termostater til elementer er ferdig koblet fra fabrikk.
- C) Påse at jordledning (gul ledning med grønn stripe) er koblet til jordingspunkt \oplus
- D) Alle elektriske koblingspunkter sjekkes og ettertrekkes iht. tabell 3.6.3. Gjentas etter ca. 3 mnd. drift. Se også pkt. 5.2 årlig kontroll.

Lokk over el-sentral skal være korrekt montert før strøm påsettes. Strøm må ikke påsettes før produktet er fylt med vann.

3.6.3 Tiltrekkingsmomenter

| Komponent | Tiltrekkingsmoment |
|------------------------------|-------------------------------|
| G1.1/4" varmeelement | 60 Nm (+/- 5) |
| Termostatskruer | 2 Nm (+/- 0,1) |
| Skruer på elementhode | 2 Nm (+/- 0,1) |
| Skruer på koblingsstykke (1) | 2,5-16 mm ² : 3 Nm |
| | 25-35 mm ² : 6 Nm |

Koblingsskjema viser standard kobling fra fabrikk (3x230V), og gjelder også for 3x400V (elementer må byttes til 415V).

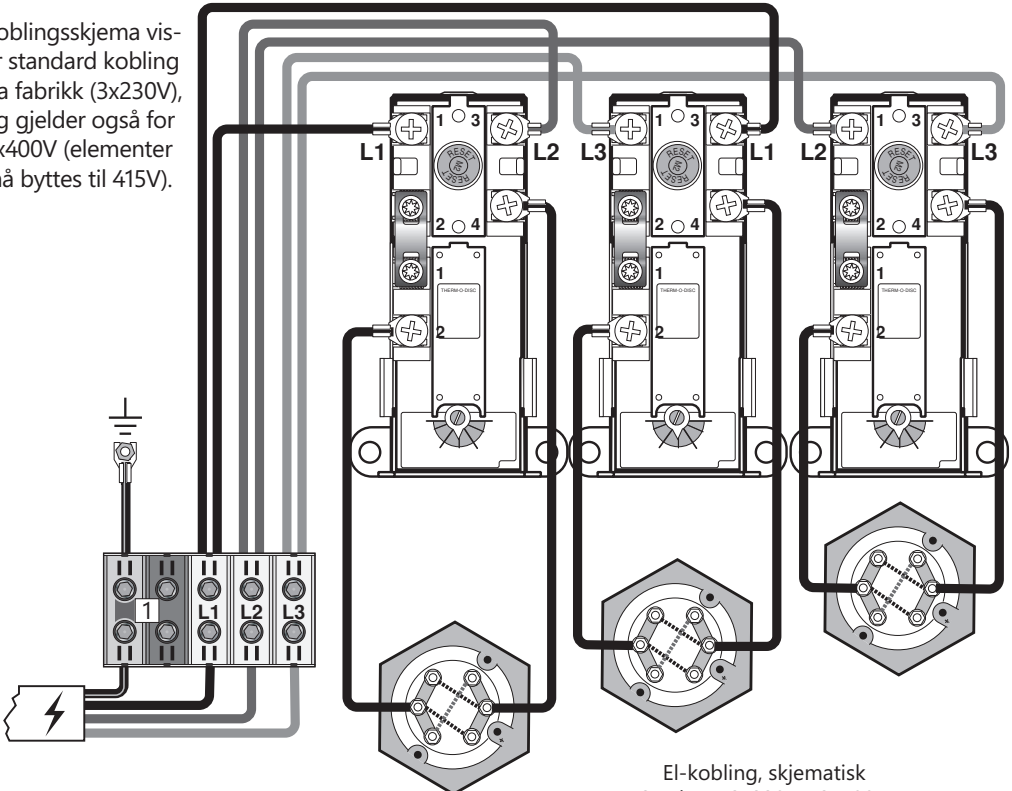

El-kobling, skjematisk
3x5 kW - 3x230V / 3x400V

3.6.4 Montasjeinstruks

⚠ ADVARSEL

| | |
|---|---|
| ❗ | Produktet skal være fylt med vann før strøm tilkobles. |
| ❗ | Fast el. montasje skal benyttes ved installasjon iht. forskrift. El-montasje skal utføres av aut. elektriker. Komponenter for frakobling må inngå i den faste el-montasjen i samsvar med gjeldende standarder og forskrifter. |
| ❗ | Nettkabel skal tåle 90°C kontinuerlig. Egnet strekkavlaster skal monteres. |

⚠ FORSIKTIG

| | |
|---|--|
| ❗ | Produktet skal ha fri serviceavstand på 40 cm foran el-sentral / 10 cm over toppanslutning. |
| ❗ | Ved evt. skade på el-tilførselskabel skal denne erstattes med ny kabel med korrekte spesifikasjoner for installasjonen. Alt el-arbeid skal utføres av aut. elektriker. |


3.6.5 Montasjeanbefaling

ANBEFALING

| | |
|---|--|
| - | Aut. elektriker skal beregne korrekt tilførselskabel og sikring iht. gjeldende standarder og forskrifter. Påse at alle ledninger ligger fritt, ikke i klem og at de er fri for skader. |
|---|--|

3.6.6 Alternativ el-kobling

El-sentral 3x230V kan bygges om til 3x400V med null-leder iht. dette skjema.

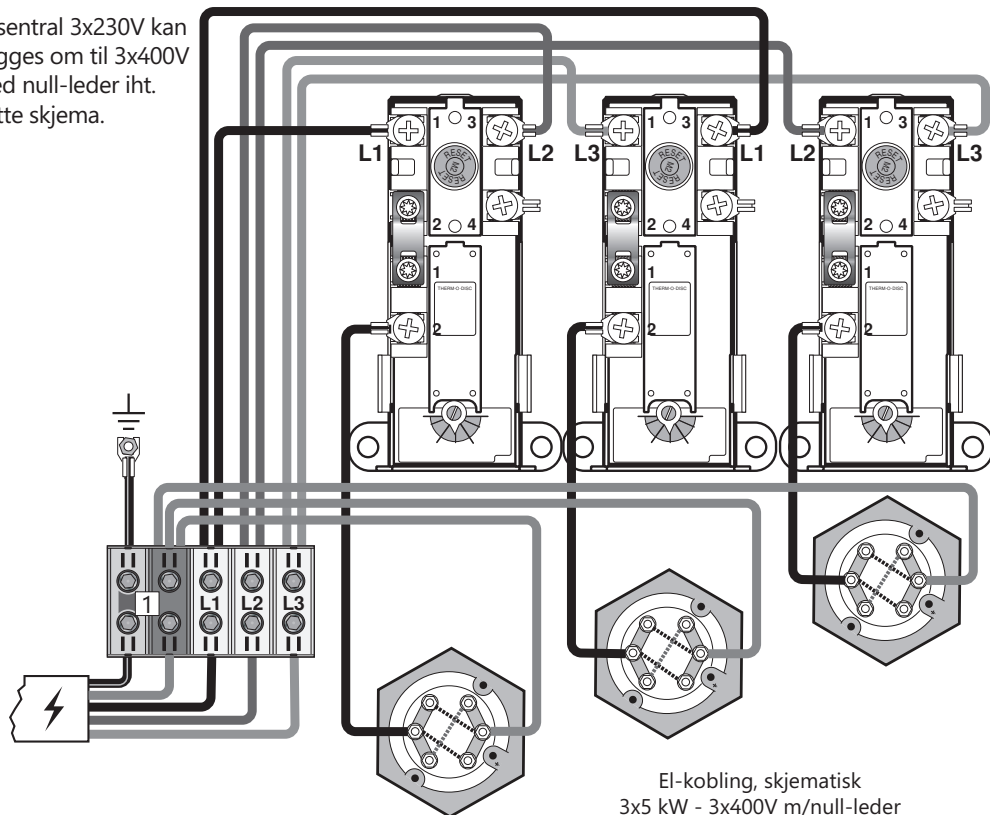

El-kobling, skjematisk
3x5 kW - 3x400V m/null-leder

4. IGANGSETTELSE FØRSTE GANG

4.1 Fylling av vann

Sjekk først at alle røranslutninger er korrekt utført. Fyll deretter tanken iht. de behov/krav som stilles av anlegget. Sørg for at tanken luftes under oppfylling slik at luftlommer unngås.

4.2 Påsettelse av strøm

Når bereder er fylt med vann kan strøm påsettes.

A) Slå på bryter/sikring.

4.3 Kontrollpunkter

- A) Sjekk at alle rørkoblinger til/fra produktet er tette og ikke lekket.
- B) Sjekk at strømtilførsel til produktet ikke er i fare for å bli utsatt for mekanisk, termisk eller kjemisk påvirkning.
- C) Sjekk at evt. overløpsrør fra sikkerhetsventil er uavstengbart og brutt, samt ligger frostfritt m/ fall til sluk.
- D) Sjekk at produktet står stabilt i lodd og i vater.

4.4 Tømming av vann

⚠ ADVARSEL

Vanntemperaturen i produktet er 75°C og medfører skoldingsfare. Før tømming utføres skal en varmtvannskran åpnes på maks trykk / temperatur i min. 3 minutter.

- A) Koble fra strømtilførselen.
- B) Steng inngående kaldt vannstilførsel.
- C) Åpne en varmtvannskran maksimalt – la stå (hindrer vacuum).
- D) Produktet tømmes via tømmeåpning (5)

Etter tømming stenges tømmeåpning (5). Steng alle åpne kraner.

4.5 Overlevering til sluttbruker


INSTALLATØR SKAL:

Instruere sluttbruker om sikkerhetsinstruks og vedlikeholdsinstruks.

Veilede sluttbruker vedr. innstillinger og tømming av produktet.

Overlevere denne montasjeanvisningen til sluttbruker.

Skrive inn kontaktinformasjon på produktets merkeplate.

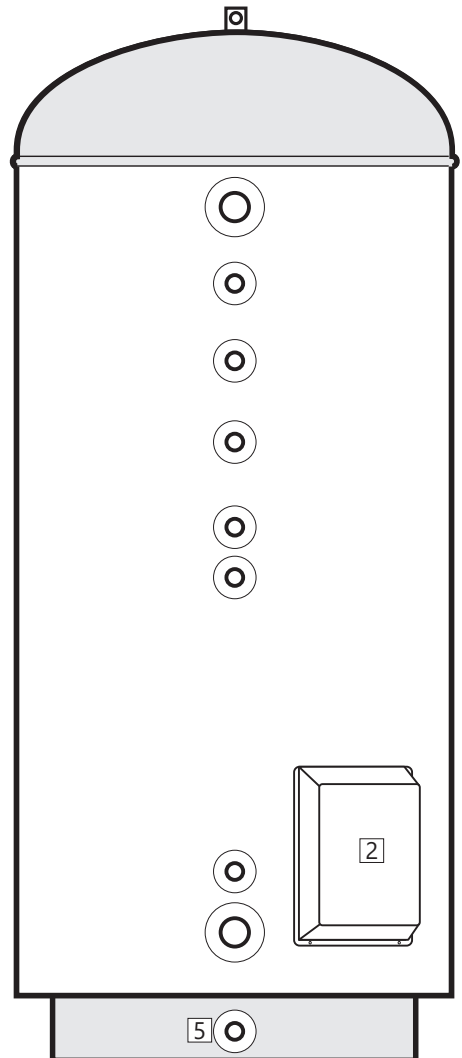

5. BRUKERVEILEDNING

5.1 Innstillinger

5.1.1 Termostatinnstilling

Produktets termostater er stillbare fra 50-75°C. Termostater bør ikke stilles lavere enn 60°C for å unngå bakterievekst. For å justere temperaturen:

- Koble fra strømtilførselen.
- Demonter el-lokket (2) med en skrutrekker.
- Juster temperatur på termostatene (3) med en skrutrekker.

Monter el-lokket (2) før strømtilførsel kobles til.

5.1.2 Resetting av sikkerhetstermostat

Produktets sikkerhetstermostater slår ut ved fare for overoppheting. Disse resettes ved å bryte strømtilførsel, demontere el-lokket (2) og trykke inn den røde "RESET"-knappen (4). Om termostaten slår ut gjentatte ganger, kontakt installatør.

5.2 Årlig kontroll


Produktet skal ha årlig ettersyn av alle komponenter montert på eller i tanken. Vedlikehold skal utføres av personer over 18 år, med tilstrekkelig kompetanse. Årlig kontroll inkluderer:

- Kontroll av tetthet ved anslutninger på alle komponenter og rørboblinger. Ettetrekkes eller tettes på forsvarlig måte ved behov.
- Ettetrekking av alle el-koblinger i el-sentralen:
 - Bryt strømtilførsel til produktet og sikre at strøm ikke kan påsettes mens arbeidet pågår.
 - Demonter el-lokket (2) og trekk til alle el-koblinger, se tiltrekkingsmomenter i tabell 3.6.3. El-lokket (2) skal monteres før strøm påsettes.
- Kontroll av sikkerhetsventil, se pkt. 5.3.

5.3 Vedlikehold


VEDLIKEHOLDSINSTRUKS

| | |
|---|---|
| ❗ | Vedlikehold skal utføres av personer over 18 år, med tilstrekkelig kompetanse. |
| ❗ | Årlig kontroll av sikkerhetsventil: |
| - | Åpne ventilen 1 minutt ved å vri rattet (1) ca. 90 grader moturs til åpen posisjon. |
| - | Kontroller visuelt at vannet renner fritt til avløp. |
| - | JA = OK. Steng ventilen ved å vri ratt (1) videre moturs til lukket posisjon. |
| - | NEI = IKKE OK. Bryt strømtilførsel / steng vanntilførsel. Kontakt installatør. |



⚠ ADVARSEL

Kontinuerlig spenning er tilstede i el.-boksen. Før elektrisk arbeid utføres skal strømtilførsel brytes og sikres mot påsetting mens arbeid pågår.

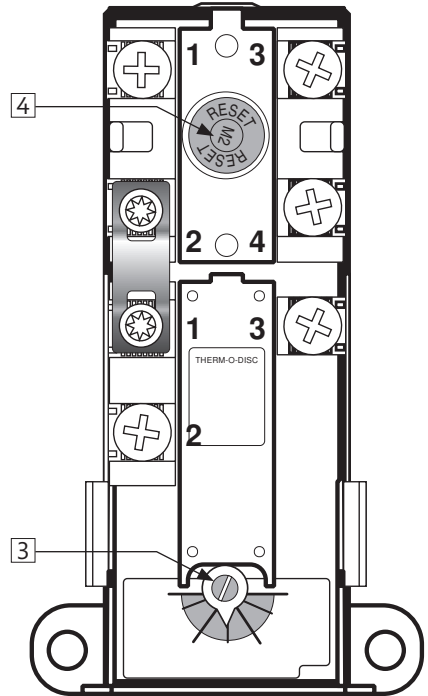

6. FEILSØKING

6.1 Feil og løsninger

Hvis det oppstår problemer med produktet under drift, sjekk mulige feilkilder i tabellen nedenfor.

Dersom det er usikkerhet rundt problemet, kontakt installatør (se produktets merkeplate) eller OSO Hotwater AS - se pkt. 7.1.

| FEILSØKING | | |
|---|--|--|
| Problem | Mulig feilårsak | Mulig løsning |
| Det renner/drypper fra sikkerhetsventilen/det er ofte vann på gulvet ved bereder om morgenen | Trykkreduksjonsventil, vannmåler eller tett tilbakeslagsventil på vanninntaket. Vanntrykket inn i anlegget er for høyt. | Monter AX ekspansjonskar som tar opp ekspansjon under oppvarming og monter trykkreduksjonsventil for stabilt vanntrykk inn i anlegget. Trykkreduksjonsventilen justeres inn ift. eksp.karets fortrykk. Kontakt aut. installatør. |
| | Sikkerhetsventilen er slitt eller det ligger partikler mellom membran og ventilsete pga. urent vann | Forsøk å spyle gjennom sikkerhetsventilen med vann. Åpne ventilen i ca. 1 minutt. Se pkt. 5.2. Hvis ventilen fremdeles renner må ventilen skiftes. Kontakt aut. installatør. |
| | Lekkasje ved varmeelement. | Verifiser ved å: a) bryte elektrisk tilførsel, b) skru av el-lokk, c) Visuelt sjekke om lekkasjen kommer fra varmeelement. I så fall: skift pakning / varmeelement. Kontakt aut. installatør. |
| Ikke varmtvann | Strømtilførsel er brutt. | Verifiser at sikringen er på / støpsel er pluggert inn i veggkontakt / jordfeilbryter ikke har slått ut. |
| | Termostat har slått ut. | Trykk inn "RESET" knapp på sikkerhetstermostat, se "Brukerveiledning". |
| | Varmeelement er defekt. | Skift varmeelement. Kontakt aut. installatør. |
| | Lekkasje på varmtvannsrør | Verifiser ved å: a) stenge vanntilførsel, b) vente 2-3 timer, c) kjenne på tanken om den er varm. I så fall er det lekkasje på varmtvannsrør eller annen lekkasje. Kontakt aut. installatør. |
| Ikke nok varmtvann | Mye forbruk i anlegget. | Bytt til en større OSO varmtvannsbereder. Kontakt aut. installatør. |
| Ikke høy nok temperatur | Termostat er stilt på for lav temperatur. | Sjekk termostatenes innstilling. Still evt. opp til 75°C, se "Brukerveiledning". |
| | Overslag i kraner fra kaldtvann til varmtvann. | Kontakt aut. installatør. |
| Sikring/jordfeilbryter slår ut gjentatte ganger | Mulig feil på berederens elektriske anlegg. | Verifiser slik: a) bryt elektrisk tilførsel, b) skru av el-lokk, c) sjekk visuelt el.-boksen for evt. problemer. Kontakt i så fall aut. elektriker for kontroll. Monter el-lokk. |
| Lang tid før varmtvannet kommer til tappested | Lange rørstrekk fra bereder til tappested. | Monter sirkulasjonsledning eller varmekabel på VV rør. Alt. monter ettervarmer ved tappested. Kontakt aut. installatør. |
| Slag i rørene når varmtvannskran stenges | Stor trykkøkning når kranen stenges hurtig. | Helt normalt. Monter AX ekspansjonskar hvis plagsomt. Kontakt aut. installatør. |

7. GARANTIBETINGELSER

1. Omfang

OSO Hotwater AS (heretter kalt OSO) garanterer at Produktet i en periode på 5 år fra kjøpsdato er; i) produsert i henhold til OSO spesifikasjoner, ii) fri for material og fabrikkasjonsfeil, under forutsetning av at nedenstående betingelser er fulgt. Alle komponenter garanteres fri for material- og produksjonsfeil i 2 år. Garantien er frivillig utvidet av OSO til 10 år for den rustfrie trykktanken. Den utvidede garantien gjelder utelukkende for Produkter kjøpt av forbruker, installert for privat bruk, distribuert av OSO eller en forhandler som opprinnelig kjøpte Produktet fra OSO og som er installert av en autorisert rørlegger.

Garanti for produkter som er kjøpt av kommersielle enheter eller som har blitt installert for kommersielt bruk reguleres utelukkende av Kjøpsloven og nedenstående forutsetninger og begrensninger for garanti.

2. Dekning

Hvis en feil oppstår og et gyldig krav er mottatt innenfor den lovpålagte garantiperioden, skal OSO, etter eget valg og innenfor lovens rammer, enten; i) reparere feilen, eller; ii) erstatte det defekte produktet med et nytt som er identisk eller tilsvarende i funksjon, eller; iii) refundere kjøpsprisen for produktet.

Hvis en feil oppstår og et gyldig krav er mottatt etter at den lovpålagte garantiperioden er utgått, men innenfor den utvidede garantiperioden, vil OSO kostnadsfritt levere et nytt produkt som er identisk eller tilsvarende i funksjon som det defekte. OSO vil i slike tilfeller ikke dekke noen øvrige kostnader forbundet med utskiftningen.

Produkter eller komponenter som skiftes ut i forbindelse med garantikrav, går over til å bli OSO sin eiendom. Produktet eller komponenten som skiftes ut medfører ikke en forlengelse av den opprinnelige garantiperioden.

3. Forutsetninger

Produktet er tilpasset vannkvaliteten fra de fleste offentlige vannverk. Imidlertid kan visse vannkvaliteter (se under) ha svært negativ effekt (medføre korrosjon) for Produktets forventede levetid. Ved usikkerhet vedrørende vannkvalitet, skal det lokale vannverket kunne informere om de nødvendige dataene.

Garantien gjelder kun dersom følgende forutsetninger er fulgt:

- Produktet har blitt installert i henhold til medfølgende montasjeanvisning og alle relevante reguleringer, forskrifter, normer og krav gjeldende på installasjonstidspunktet.
- Produktet ikke har blitt modifisert, endret, utsatt for unormale påvirkninger og at ingen fabrikk-monterte eller medfølgende deler er fjernet.
- Produktet kun har vært tilkoblet offentlig vannverk, vært i

jevnlig bruk, og at vannkvaliteten er iht. følgende:

- Klorider < 75 mg / L*
- Konduktivitet (EC) ved 25°C < 230 µS / cm*

*Ved høyere verdier skal anode monteres før vann påfylles produktet.

- Varmeelementet ikke har vært utsatt for vann med hardhet over 5°dH (90 mg/L CaCO₃).
- Enhver form for desinfisering av røranlegget har blitt utført uten å påvirke produktet. Produktet skal isoleres fra enhver form for klorinering.
- Produktet har vært i jevnlig bruk fra og med installasjonsdato. Dersom Produktet ikke skal brukes på 60 dager eller mer, må det tappes ned.
- Service og vedlikehold har blitt gjennomført av en kyndig person iht. kravene i medfølgende montasjeanvisning og alle relevante tekniske forskrifter. Enhver komponent benyttet ifm. service er en original OSO reservedel.
- Enhver garantikostnad har blitt skriftlig godkjent av OSO før den påløper.
- Kjøpskvittering og/eller kvittering for installasjonen, en vannprøve samt det defekte produktet blir gjort tilgjengelig for OSO på forespørsel.

Dersom ovenstående forutsetninger ikke etterfølges kan det resultere i at Produktet blir skadet, og påfølgende vannlekkasje.

4. Begrensninger

Garantien dekker ikke:

- Enhver form for feil eller kostnad som oppstår som følge av ukorrekt installasjon eller bruk, manglende vedlikehold, forsømmelse, misbruk, endring eller reparasjon utført på feil måte eller enhver feil som oppstår som følge av endring av produktet fra sin originale form.
- Noen form for følgeskader eller indirekte tap som følge av Produktfeil eller manglende leveranse fra Produktet.
- Enhver skade forårsaket av frost, overtrykk, overspenning, tørrkoking eller klorbehandling.
- Feil forbundet med stillestående vann dersom Produktet ikke har vært i bruk på > 60 dager i strekk.
- Tilkoblet røropplegg eller utstyr tilkoblet Produktet.
- Transportskader. Transportøren skal gjøres oppmerksom på slike skader ved mottak.
- Kostnader som følge av at produktet ikke er enkelt tilgjengelig for service.

Denne garantien begrenser ikke Kjøpers lovbestemte rettigheter på noen måte.

A) Installatøren som leverte produktet.

B) OSO Hotwater AS: Tlf. 32 25 00 00

oso@oso.no / www.oso.no

7.1 Kundeservice

Ved problemer som ikke er løsbare etter gjennomgang av feilsøkingsguiden i denne montasjeanvisningen (pkt. 6.1), kontakt enten:

8. DEMONTERING AV PRODUKTET

8.1 Demontering

- A) Koble fra varmekilde.
- B) Steng inngående kaldtvannstilførsel.
- C) Tøm produktet for vann – se punkt. 4.4.
- D) Koble fra alle røranslutninger.
- E) Produktet kan nå fjernes.

8.2 Returordning

Dette produktet er resirkulerbart, og bør leveres på miljøgjenvinningsstasjon. Dersom produktet erstattes av et nytt kan installatør ta med seg gammel bereder til gjenvinning.

OSO

HOTWATER

OSO Hotwater AS

Industriveien 1
3300 Hokksund - Norway
Tel: +47 32 25 00 00
oso@oso.no
www.osohotwater.com

Maxi Coil - MC

600-1000 l.

EN

SAFETY INFORMATION
O&M INFORMATION
INSTALLATION MANUAL



Manufactured by OSO Hotwater AS
Industriveien 1 - 3300 Hokksund - Norway
Tel: +47 32 25 00 00 / E-mail: oso@oso.no
www.osohotwater.com

11002346-146194-03B - 03-2023

OSO
HOT WATER


CONTENTS

| | |
|--|----|
| 1. Safety instructions | 3 |
| 1.1 General information..... | 3 |
| 1.2 Safety instructions for users..... | 4 |
| 1.3 Safety instructions for installers..... | 4 |
| 2. Product description | 5 |
| 2.1. Product identification..... | 5 |
| 2.2. Intended use..... | 5 |
| 2.3 CE marking..... | 5 |
| 2.4 Technical data..... | 5 |
| 3. Installation instructions | 6 |
| 3.1. Products covered by these instructions | 6 |
| 3.2. Included in delivery..... | 6 |
| 3.3. Product dimensions..... | 6 |
| 3.4. Requirements for installation location .. | 7 |
| 3.5. Pipe installation..... | 8 |
| 3.6. Electrical installation..... | 10 |
| 4. Initial commissioning | 12 |
| 4.1. Filling with water..... | 12 |
| 4.2. Turning on the power..... | 12 |
| 4.3. Control points..... | 12 |
| 4.4. Emptying of water..... | 12 |
| 4.5. Handover to end-user..... | 12 |
| 5. User Guide | 13 |
| 5.1. Settings..... | 13 |
| 5.2. Annual inspection..... | 13 |
| 5.3. Maintenance..... | 13 |
| 6. Troubleshooting | 14 |
| 6.1. Faults and fixes..... | 14 |
| 7. Warranty conditions | 15 |
| 7.1. Warranty and registration..... | 15 |
| 7.2. Customer service..... | 15 |
| 8. Removing the product | 15 |
| 8.1. Removal..... | 15 |
| 8.2. Returns scheme..... | 15 |

1. SAFETY INSTRUCTIONS

1.1 General information



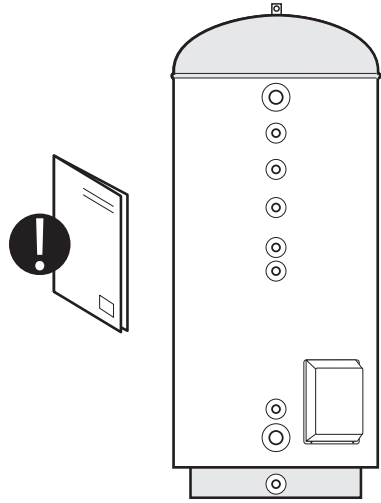


- Read the following safety instructions carefully before installing, maintaining or adjusting the buffer tank.
- Personal injury or material damage may result if the product is not installed or used in the intended manner.
- Keep this manual and other relevant documents where they are accessible for future reference.
- The manufacturer assumes compliance (by the end-user) with the safety, operating and maintenance instructions supplied and (by the installer) with the fitting manual and relevant standards and regulations in effect at the date of installation.






Symbols used in this manual:





| | | |
|--|---------|--|
| | WARNING | Could cause serious injury or death |
| | CAUTION | Could cause minor or moderate injury or damage to property |
| | DO NOT | |
| | DO | |





1.2 Safety instructions for users

|  WARNING | |
|---|---|
|  | The overflow from the safety valve shall NOT be sealed or plugged. |
|  | The product shall NOT be modified or changed from its original state. |
|  | Children shall NOT play with the product or go near it without supervision. |
|  | Maintenance/settings shall only be carried out by persons over 18 years of age, with sufficient understanding |

|  CAUTION | |
|---|--|
|  | The product must not be exposed to frost, over-pressure, over-voltage or chlorine treatment. See warranty provisions. |
|  | Maintenance/settings shall not be carried out by persons of diminished physical or mental capacity, unless they have been instructed in the correct use by someone responsible for their safety. |

1.3 Safety instructions for installers

|  WARNING | |
|---|---|
|  | The overflow from the safety valve shall NOT be sealed or plugged. Safety valve is supplied with the product. |
|  | The discharge pipe from any safety device shall be at least one pipe size larger than the nominal outlet size of the safety device (< 9m length). The discharge pipe shall have continuous fall to drain, be uninterrupted and frost-free at all times. |
|  | The relevant regulations and standards, and this installation manual, must be followed. |

|  CAUTION | |
|---|---|
|  | The product shall be placed in a room with a floor drain. The manufacturer assumes no responsibility whatsoever if this provision is not followed. |
|  | The product shall be properly aligned vertically and horizontally, on a floor or wall suitable for the total weight of the product when in operation. See type plate. |
|  | The product must have a clearance for servicing of 40 cm in front of the electric junction box cover. |

2. PRODUCT DESCRIPTION

2.1 Product identification

Identification details for your product can be found on the type plate fixed to the product. The type plate contains details of the product in accordance with EN 12897:2016 and EN 60335-2-21, as well as other useful data. See Declaration of Conformity at www.osohotwater.com for more information.

OSO products are designed and manufactured in accordance with:

- Pressure vessel standard PED 2014/68/EU
- Safety standard EN 60335-2-21
- Welding standard EN ISO 3834-2

OSO Hotwater AS is certified for

- Quality ISO 9001
- Environment ISO 14001
- Work environment ISO 45001

2.4 Technical data

| NRF no. | Product code: | Capacity persons | Weight kg. | Diameter x height mm | Freight vol. m ³ | Heating time hours Δt 65°C | Actual vol. l. |
|---|--|------------------------|------------|-------------------------|-----------------------------|------------------------------------|----------------|
| 800 1773 | MC 600 - 15 kW / 3x230V + HX 1.0 m ² | - | 143 | ø780x2030 | 1.28 | - | 567 |
| 800 1754 | MC 1000 - 15 kW / 3x230V + HX 1.0 m ² | - | 244 | ø1000x2100 | 2.29 | - | 877 |
| Directive: 2010/30/EU Regulation: EU 812/2013 | | Directive: 2009/125/EC | | Regulation: EU 814/2013 | | | |
| Heat loss tested acc. to standard: EN 12897: 2015 | | | | | | | |

The products are rated IP21.

2.2 Intended use

The Maxi Coil is designed for use as a buffer for tap water at electrical peak load. The MC is fitted for external energy sources.

2.3 CE marking



The CE mark shows that the product complies with the relevant Directives. See Declaration of Conformity at www.osohotwater.com for more information.

The product complies with Directives for:

- Low voltage LVD 2014/35/EU
- Electromagnetic compatibility EMC 2014/30/EU
- Pressurised equipment PED 2014/68/EU

The safety valve(s) used must be CE marked and conform to PED 2014/68/EU.

3. INSTALLATION INSTRUCTIONS

3.1 Products covered by these instructions

800 1773 Maxi Coil - MC 600 - 3x230V

800 1754 Maxi Coil - MC 1000 - 3x230V

3.2 Included in delivery




| Ref no. | Pcs. | Description |
|---------|------|--|
| 1 | 1 | Buffer tank with electrical peak load + coil |
| 2 | 1 | Installation manual (this document) |
| 3 | 1 | Anode (factory-fitted) |
| 4 | 2 | PT safety valve (supplied) |
| 5 | 1 | Junction box with 3 elements/thermostats |

3.3 Product dimensions

All dimensions in mm.


| Product. | A | B HW | C Coil | D Coil | E CW | ∅ |
|----------|------|---------|-----------|-----------|---------|------|
| MC 600 | 2030 | 1530 | 830 | 380 | 260 | 780 |
| MC 1000 | 2100 | 1680 | 990 | 430 | 310 | 1000 |

Tolerance +/- 5 mm.

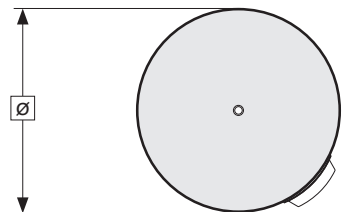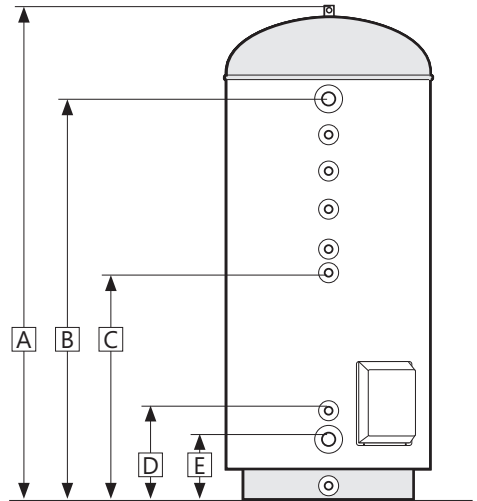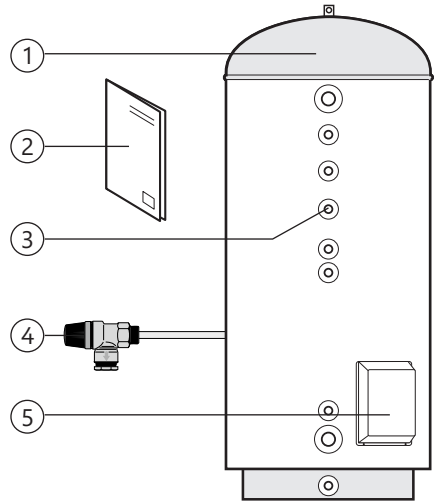

3.3.1 Delivery

The product should be transported carefully as shown, with packaging.

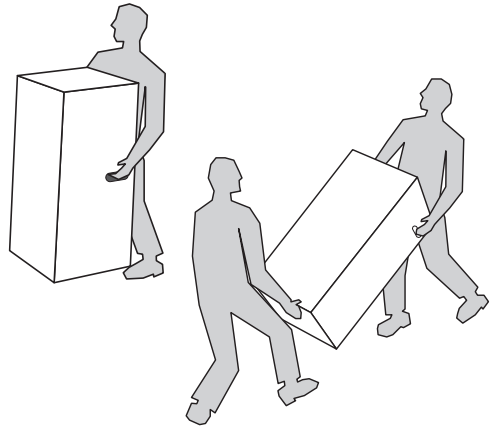



⚠ CAUTION

Pipe stubs, valves etc. should not be used to lift the product as this could cause malfunctions.

3.4 Requirements for installation location and positioning

⚠ CAUTION


- ❗ The product shall be placed in a room with a floor drain. The manufacturer assumes no responsibility whatsoever if this provision is not followed.
- ❗ The product should be placed in a dry and permanently frost-free position.
- ❗ The product should be placed on a floor or wall suitable for the total weight of the product when in operation. See type plate.
- ❗ The product must have a clearance for servicing of 40 cm in front of the electric junction box cover.
- ❗ The product should be easily accessible for servicing and maintenance.

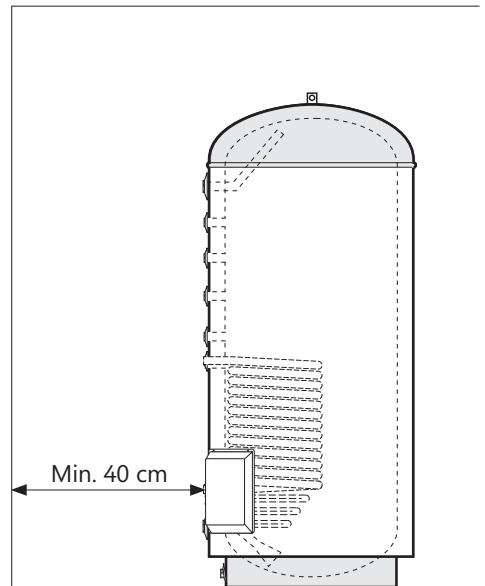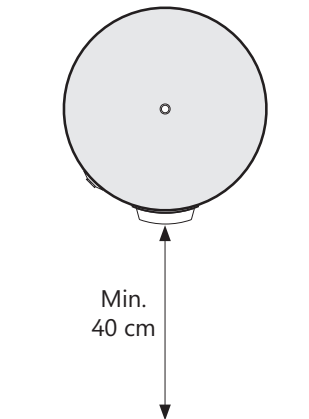

3.5 Pipe installation

The product is designed to be permanently connected to the mains water supply. Approved pipes of the correct size should be used for installation. The relevant standards and regulations must be followed.

| No. | Dimension | Connection description |
|-----|----------------------|--------------------------------|
| 1 | 1½" internal thread. | Hot water out |
| 2 | ¾" internal thread. | PT safety valve 1 |
| 3 | ¾" internal thread. | Hot water circulation/thermom. |
| 4 | ¾" internal thread. | Anode (factory-fitted) |
| 5 | ¾" internal thread. | PT safety valve 2 |
| 6 | 1" int. thread | Coil connection, upper |
| 7 | 1" int. thread | Coil connection, lower |
| 8 | 1½" internal thread. | Cold water in |
| 9 | 1" int. thread | Draining |

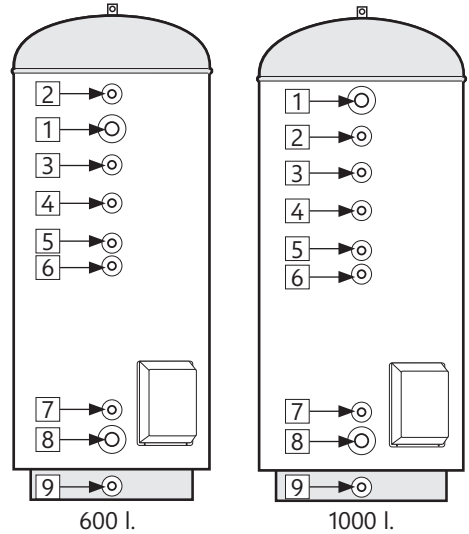


3.5.1 Incoming water pressure

The efficiency of the product depends on the incoming cold water pressure. The water pressure should be min. 2 bar and max. 6 bar throughout the day. Excessive water pressure can be adjusted by installing a pressure reduction valve.

3.5.2 Fitting pipes


- Run a pipe of suitable size to the connections shown, and affix with suitable sealant. Unused connections must be plugged securely.
- The product can be connected in series for increased capacity in the system. Use OSO prefabricated SRS manifolds. See illustration.

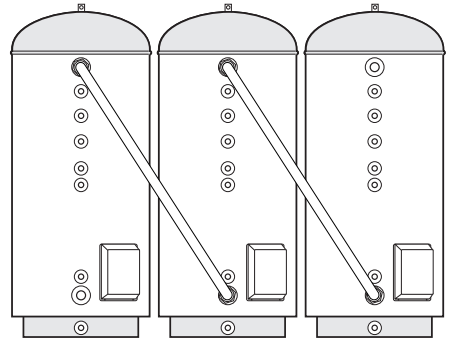





3.5.3 Fitting of overflow pipe

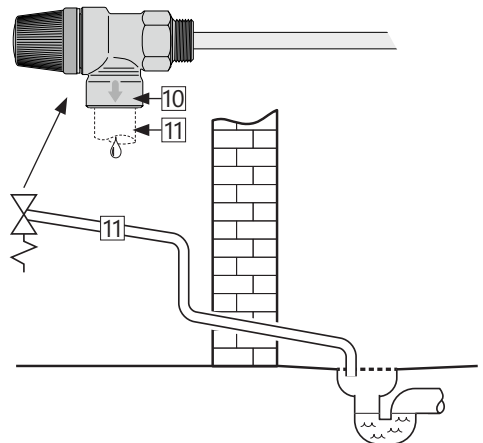Overflow pipe (11) ≥ 18 mm inside run to PT safety valve;

- Connected to the overflow (10) of the PT safety valve (¾" internal thread).
- Clear, undamaged and frost-free with a fall to the drain.



3.5.4 Fitting instructions

|  CAUTION | |
|---|--|
|  | The product shall be placed in a room with a floor drain. The manufacturer assumes no responsibility whatsoever if this provision is not followed. |
|  | The product should be properly aligned vertically and horizontally, on a floor suitable for the total weight of the product when in operation. See type plate. |
|  | The product must have a clearance for servicing of 40 cm in front of the electric junction box cover. |

3.5.5 Fitting recommendation

| RECOMMENDATION | |
|----------------|--|
| - | If the maximum water pressure exceeds 6 bar in a 24-hour period, a reduction valve and expansion vessel should be fitted. |
| - | For installation in a rooms which does not conform to the wetroom standard, a watertight drip tray with overflow pipe \geq 18 mm. inside diameter should be fitted under the product, in addition to an automatic stop cock with sensor. This will prevent possible material damage. |

3.6 Electrical installation

Fixed electrical fittings must be used for installation. Any electric fittings must be installed by an authorised electrician. The relevant standards and regulations must be followed.

3.6.1 Electrical components


| Component | Note |
|-------------------|----------------------|
| Safety thermostat | 95°C thermal cut-out |
| Work thermostat | 50-75°C adjustable |
| Heating element | 3-phase 230 V |
| Internal wires | Heat-resistant |

3.6.2 Electrical connections in the junction box

| ⚠ WARNING |
|--|
| Constant voltage present at the terminals. Before any electrical work is done, the power supply must be disconnected and secured against activation while the work is in progress. |

A) Supply cable connected to terminal (1) as shown. Supply wires should be secured with

suitable strain relievers.


- B) Internal wires from connection piece (1) to thermostats and the wires from thermostats to elements are pre-connected from the factory.
 C) Make sure that the earth wire (yellow wire with green stripe) is connected to the earthing point 

Cover of junction box should be correctly mounted before the power is switched on. The power must not be switched on until the product has been filled with water.

3.6.3 Torque settings

| Component | Torque |
|---------------------------|-------------------------------|
| G1.1/4" heating element | 60 Nm (+/- 5) |
| Thermostat screws | 2 Nm (+/- 0,1) |
| Screw on the element head | 2 Nm (+/- 0,1) |
| Screws on terminal (1) | 2,5-16 mm ² : 3 Nm |
| | 25-35 mm ² : 6 Nm |

Circuit diagram shows standard connection from the factory (3x230V), and also applies to 3x400V (elements need to be changed to 415V).

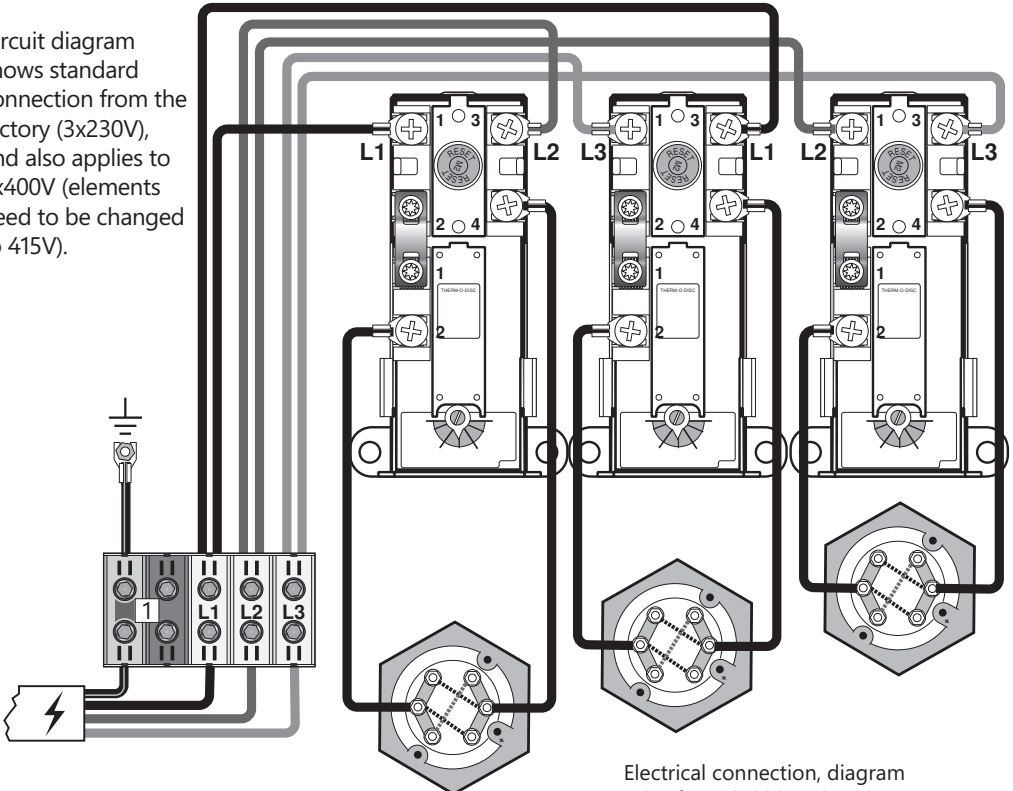

Electrical connection, diagram
 3x5 kW - 3x230V / 3x400V

3.6.4 Fitting instructions

⚠ WARNING

| | |
|---|--|
| ❗ | The product should be filled with water before the power is switched on. |
| ❗ | Fixed electrical fittings must be used for installation according to the regulations. Any electric fittings must be installed by an authorised electrician. Components for disconnection must be integrated in the electric connection in accordance with current standards and regulations. |
| ❗ | The mains cable should withstand 90°C. A suitable strain reliever must be fitted. |

⚠ CAUTION

| | |
|---|---|
| ❗ | The product must have a clearance for servicing of 40 cm in front of the electric junction box cover. |
| ❗ | In case of damage to the power supply cable, this should be replaced with new cable with the correct specifications for the installation. All electrical work should be performed by an authorised electrician. |


3.6.5 Fitting recommendation

RECOMMENDATION

| | |
|---|---|
| - | An authorized electrician should calculate the correct supply cable and fuse according to the applicable standards and regulations. Make sure all wires are undamaged and are not pinched.. |
|---|---|

3.6.6 Alternative electrical connection

Junction box 3x230V can be converted to 3x400V with neutral wire according to this diagram.

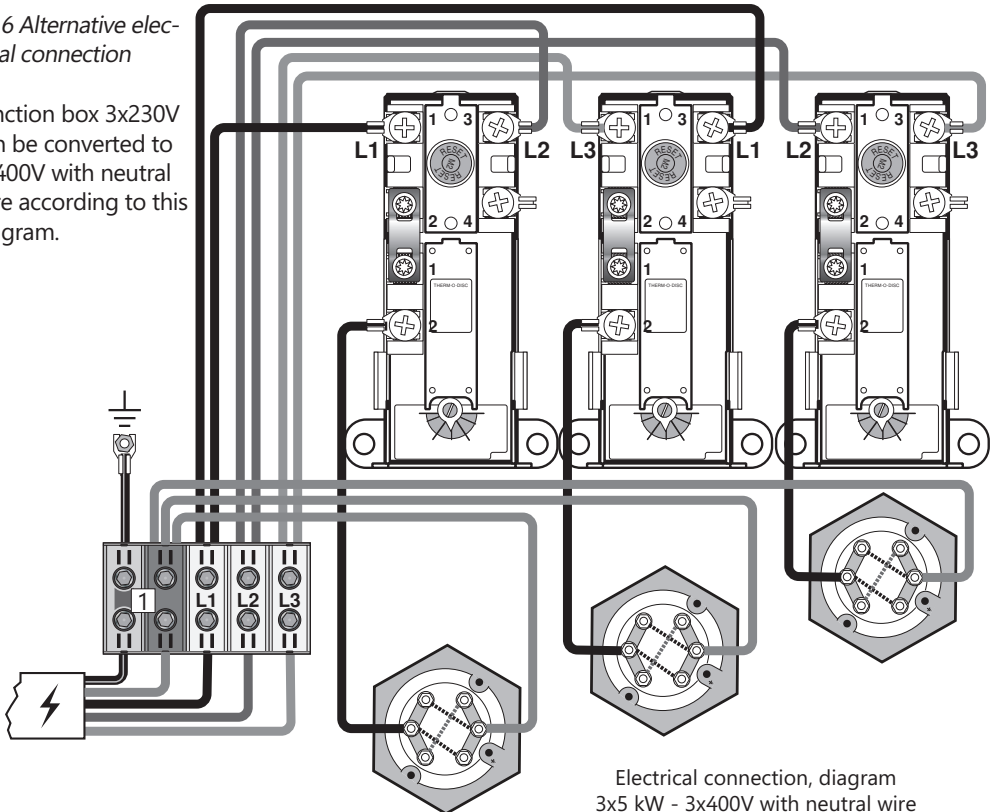

Electrical connection, diagram
3x5 kW - 3x400V with neutral wire

4. INITIAL COMMISSIONING

4.1 Filling with water

First check that all pipes are connected correctly. Then fill the tank according to the needs/requirements of the system. Make sure that the tank is vented during filling to prevent air pockets.

4.2 Turning on the power

When the cylinder has been filled with water, the power can be switched on.

A) Switch on breaker/fuse.

4.3 Control points

A) Check that all pipe connections to/from the product are tight and not leaking.

B) Check that the power supply to the product is not at risk of exposure to mechanical, thermal or chemical damage.

C) Check that any overflow pipe from the safety valve is clear, undamaged and frost-free with a fall to the drain.

D) Check that the product is standing firmly vertically and horizontally.

4.4 Emptying of water

| |
|---|
|  WARNING |
|---|

| |
|---|
| The water temperature in the product is 75°C and could cause scalding. Before emptying, a hot tap should be opened to the max. pressure/temperature for min. 3 minutes. |
|---|

A) Disconnect the power supply.

B) Shut off incoming cold water supply.

C) Open a hot tap to the maximum – leave open (prevents vacuum).

D) The product is emptied via the drain pipe (5)

After emptying, close the drain pipe (5). Close all open taps.

4.5 Handover to end-user


| |
|---------------------|
| THE INSTALLER MUST: |
|---------------------|

| |
|--|
| Brief the end-user on safety and maintenance instructions. |
|--|

| |
|--|
| Brief the end-user on settings and emptying the product. |
|--|

| |
|---|
| Hand this installation manual over to the end-user. |
|---|

| |
|---|
| Enter contact details on the type plate on the product. |
|---|

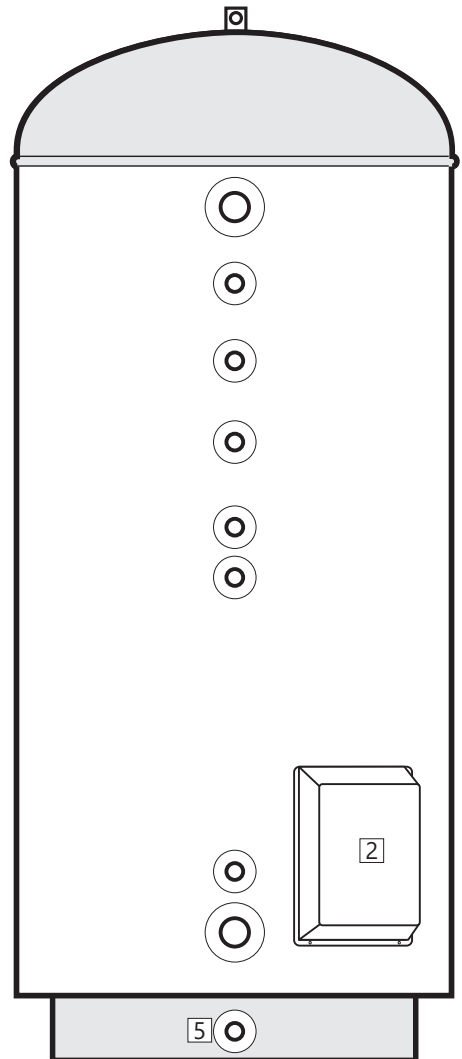

5. USER GUIDE

5.1 Settings

5.1.1 Thermostat setting

The product's thermostats are adjustable from 50-75°C. The thermostat should not be set lower than 60°C to prevent bacteria growth. To adjust the temperature:

- A) Disconnect the power supply.
- B) Remove the cover (2) with a screwdriver.
- C) Adjust the temperature on the thermostats (3) with a screwdriver.

Fit the cover (2) before connecting the power supply.

5.1.2 Resetting the safety thermostat

The safety thermostats on the product cut out when there is a risk of overheating. These are reset by switching off the power supply, removing the cover (2) and pressing the red 'RESET' button (4). If the thermostat cuts out repeatedly, contact the installer.

5.2 Annual inspection


All components fitted in or to the product must be inspected annually. Inspection must be performed by person older than 18 years of age, with appropriate qualifications. Annual inspection includes:

- Checking all connections for leaks. Tighten or maintain properly if required..
- Tighten all connections in the electric junction box:
 - A) Disconnect power supply and ensure against activation while work is in progress.
 - B) Remove junction box cover (2) and tighten all connections to the correct torque as shown in table 3.6.3. The junction box cover must be refitted before power is turned back on.
- Inspection of safety valve operation, see pt. 5.3.

5.3 Maintenance


MAINTENANCE INSTRUCTIONS

| | |
|---|---|
| ⚠ | Maintenance should be carried out by persons over 18 years of age, with sufficient understanding. |
| ⚠ | Annual inspection of safety valve: |
| - | Open valve for 1 min. by turning the knob (1) counterclockwise to the open position. |
| - | Visually check that the water is flowing freely to the drain. |
| - | YES = OK. Close the valve by turning knob (1) further counterclockwise until valve shuts. |
| - | NO = NOT OK. Disconnect power supply / shut off water supply. Contact installer. |



⚠ WARNING

Constant voltage is present in the junction box. Before any electrical work is done, the power supply must be disconnected and secured against activation while the work is in progress.

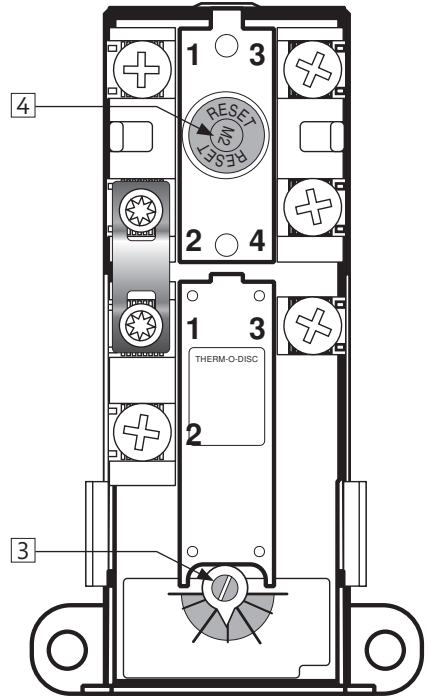

6. TROUBLESHOOTING

6.1 Faults and fixes

If problems arise when the product is in use, check for possible faults and fixes in the table. If you are unsure what is wrong, contact the

installer (see product type plate) or OSO Hot-water AS - see section 7.1.

| TROUBLESHOOTING | | |
|--|--|---|
| Problem | Possible cause of fault | Possible solution |
| There is leakage/dripping from the safety valve/ there is often water on the floor by the cylinder in the morning | Pressure reduction valve, water meter or blocked non-return valve on the water intake. | Fit AX expansion vessel which absorbs expansion during heating, and fit pressure reduction valve for stable water pressure inside the system. The pressure reduction valve is adjusted in according to the pressure in the expansion vessel. Contact auth. installer. |
| | Water pressure into the system is too high. | |
| | The safety valve is worn or there are particles stuck between the membrane and the valve seat because the water is dirty | Try to flush with water through the safety valve. Open valve for approx. 1 minute. See section 5.2. If the valve still leaks, it must be replaced. Contact auth. installer. |
| | Leak from heating element. | Verify as follows: a) cut the electric supply, b) unscrew the cover, c) visually check whether there is a leak from the heating element. If so, replace the gasket/heating element. Contact auth. installer. |
| No hot water | Power supply interrupted. | Verify that the fuse is on / the plug is plugged in to the wall contact / the earth breaker has not tripped. |
| | Thermostat has cut out. | Press the 'RESET' button on the safety thermostat; see 'User guide'. |
| | Heating element is defective. | Replace heating element. Contact auth. installer. |
| | Leak in hot water pipe | Verify as follows: a) close the water supply, b) wait 2-3 hours, c) feel the tank to see whether it is hot. If so, there is a leak in the hot water pipe or elsewhere. Contact auth. installer. |
| Not enough hot water | High consumption in the system. | Switch to a larger OSO water heater. Contact auth. installer. |
| Not high enough temperature | The thermostat is set for low temperatures. | Check the thermostat settings. Turn up to 75°C; see 'User guide'. |
| | Change from cold to hot water in taps. | Contact auth. installer. |
| Fuse/earth breaker trips repeatedly | Possible fault in the heater's electrical system. | Verify as follows: a) cut the electric supply, b) unscrew the cover, c) visually check the junction box for any problems. If so, contact auth. installer to check. Fit the cover. |
| Long time before the water reaches the tap | Long stretch of pipe from water heater to tap. | Fit circulation wire or heating cable to HW pipe. Or fit an auxiliary heater by the tap. Contact auth. installer. |
| Knocking in the pipes when the hot tap is closed | Large pressure increase when the tap is closed quickly. | Completely normal. Fit AX expansion vessel if troublesome. Contact auth. installer. |

7. WARRANTY CONDITIONS

1. Scope

OSO Hotwater AS (hereinafter called OSO) warrants for 2 years from the date of purchase, that the Product will: i) conform to OSO specification, ii) be free from defects in materials and workmanship, subject to conditions below. All components carry a 2-year warranty.

The warranty is voluntarily extended by OSO to 5 years for the stainless steel inner tank. This extended warranty only applies to Products purchased by a consumer, that has been installed for private use and that has been distributed by OSO or by a distributor where the Products have been originally sold by OSO. The extended warranty does not apply to Products purchased by commercial entities or for Products that have been installed for commercial use. These shall be subject only to the mandatory provisions of the law. The conditions and limitations set out below shall apply.

2. Coverage

If a defect arises and a valid claim is received within the statutory warranty period, at its option and to the extent permitted by law, OSO shall either: i) repair the defect, or; ii) replace the product with a product that is identical or similar in function, or; iii) refund the purchase price.

If a defect arises and a valid claim is received after the statutory warranty period has expired, but within the extended warranty period, OSO will supply a product that is identical or similar in function. OSO will in such cases not cover any other associated costs.

Any exchanged Product or component will become the legal property of OSO. Any valid claim or service does not extend the original warranty. The replacement Product or part does not carry a new warranty.

3. Conditions

The Product is manufactured to suit most public water supplies. However, there are certain water chemistries (outlined below) that can have a detrimental effect on the Product and its life expectancy. If there are uncertainties regarding water quality, the local water supply authority can supply the necessary data.

The warranty applies only if the conditions set out below are met in full:

- The Product has been installed by a professional installer, in accordance with the instructions in the installation manual and all relevant Codes of Practice and Regulations in force at the time of installation.
- The Product has not been modified in any way, tampered with or subjected to misuse and no factory fitted parts have been removed for unauthorized repair or replacement.
- The Product has only been connected to a domestic mains water supply in compliance with the European Drinking Water Directive EN 98/83 EC, or latest version. The water

should not be aggressive, i.e. the water chemistry shall comply with the following:

| | |
|------------------------------------|----------------|
| - Chloride | < 250 mg / L |
| - Electric Conductivity (EC) @25°C | < 750 uS / cm |
| - Saturation Index (LSI) @80°C | > -1,0 / < 0,8 |
| - pH level | > 6,0 / < 9,5 |

- The immersion heater has not been exposed to hardness levels exceeding 10°dH (180 ppm CaCO₃). A water softener is recommended in such cases.
- Any disinfection has been carried out without affecting the Product in any way whatsoever. The Product shall be isolated from any system chlorination.
- The Product has been in regular use from the date of installation. If the Product is not intended to be used for 60 days or more, it must be drained.
- Service and/or repair shall be done according to the installation manual and all relevant codes of practice. Any replacement parts used shall be original OSO spare parts.
- Any third-party costs associated with any claim has been authorized in advance by OSO in writing.
- The purchase invoice and/or installation invoice, a water sample as well as the defective product is made available to OSO upon request.

Failure to follow these instructions and conditions may result in product failure, and water escaping from the Product.

4. Limitations

The warranty does not cover:

- Any fault or costs arising from incorrect installation, incorrect application, lack of regular maintenance in accordance with the installation manual, neglect, accidental or malicious damage, misuse, any alteration, tampering or repair carried out by a non-professional, any fault arising from the tampering with or removal of any factory fitted safety components or measures.
- Any consequential damage or any indirect loss caused by any failure or malfunction of the Product whatsoever.
- Any pipework or any equipment connected to the Product.
- The effects of frost, lightning, voltage variation, lack of water, dry boiling, excess pressure or chlorination procedures.
- The effects of stagnant (de-aerated) water if the Product has been left unused for more than 60 days consecutively.
- Damage caused during transportation. Buyer shall give the carrier notice of such damage.
- Costs arising if the Product is not immediately accessible for servicing.

These warranties do not affect the Buyer's statutory rights.

7.1 Customer service

In case of problems that cannot be resolved with the aid of the troubleshooting guide in this installation manual, contact either:

- A) The installer who supplied the product.
- B) OSO Hotwater AS: Tel.: +47 32 25 00 00
oso@oso.no / www.oso.no

8. REMOVING THE PRODUCT

8.1 Removal

- A) Disconnect the power supply.
- B) Shut off incoming cold water supply.
- C) Empty the product of water – see section 4.4.
- D) Disconnect all pipes.
- E) The product can now be removed.

8.2 Returns scheme

This product is recyclable and should be taken to the environmental recycling centre. If the product is to be replaced with a new one, the installer can take the old cylinder away for recycling.

OSO

HOTWATER

OSO Hotwater AS

Industriveien 1
3300 Hokksund - Norway
Tel: + 47 32 25 00 00
oso@oso.no
www.osohotwater.com